



element
TRA-061998




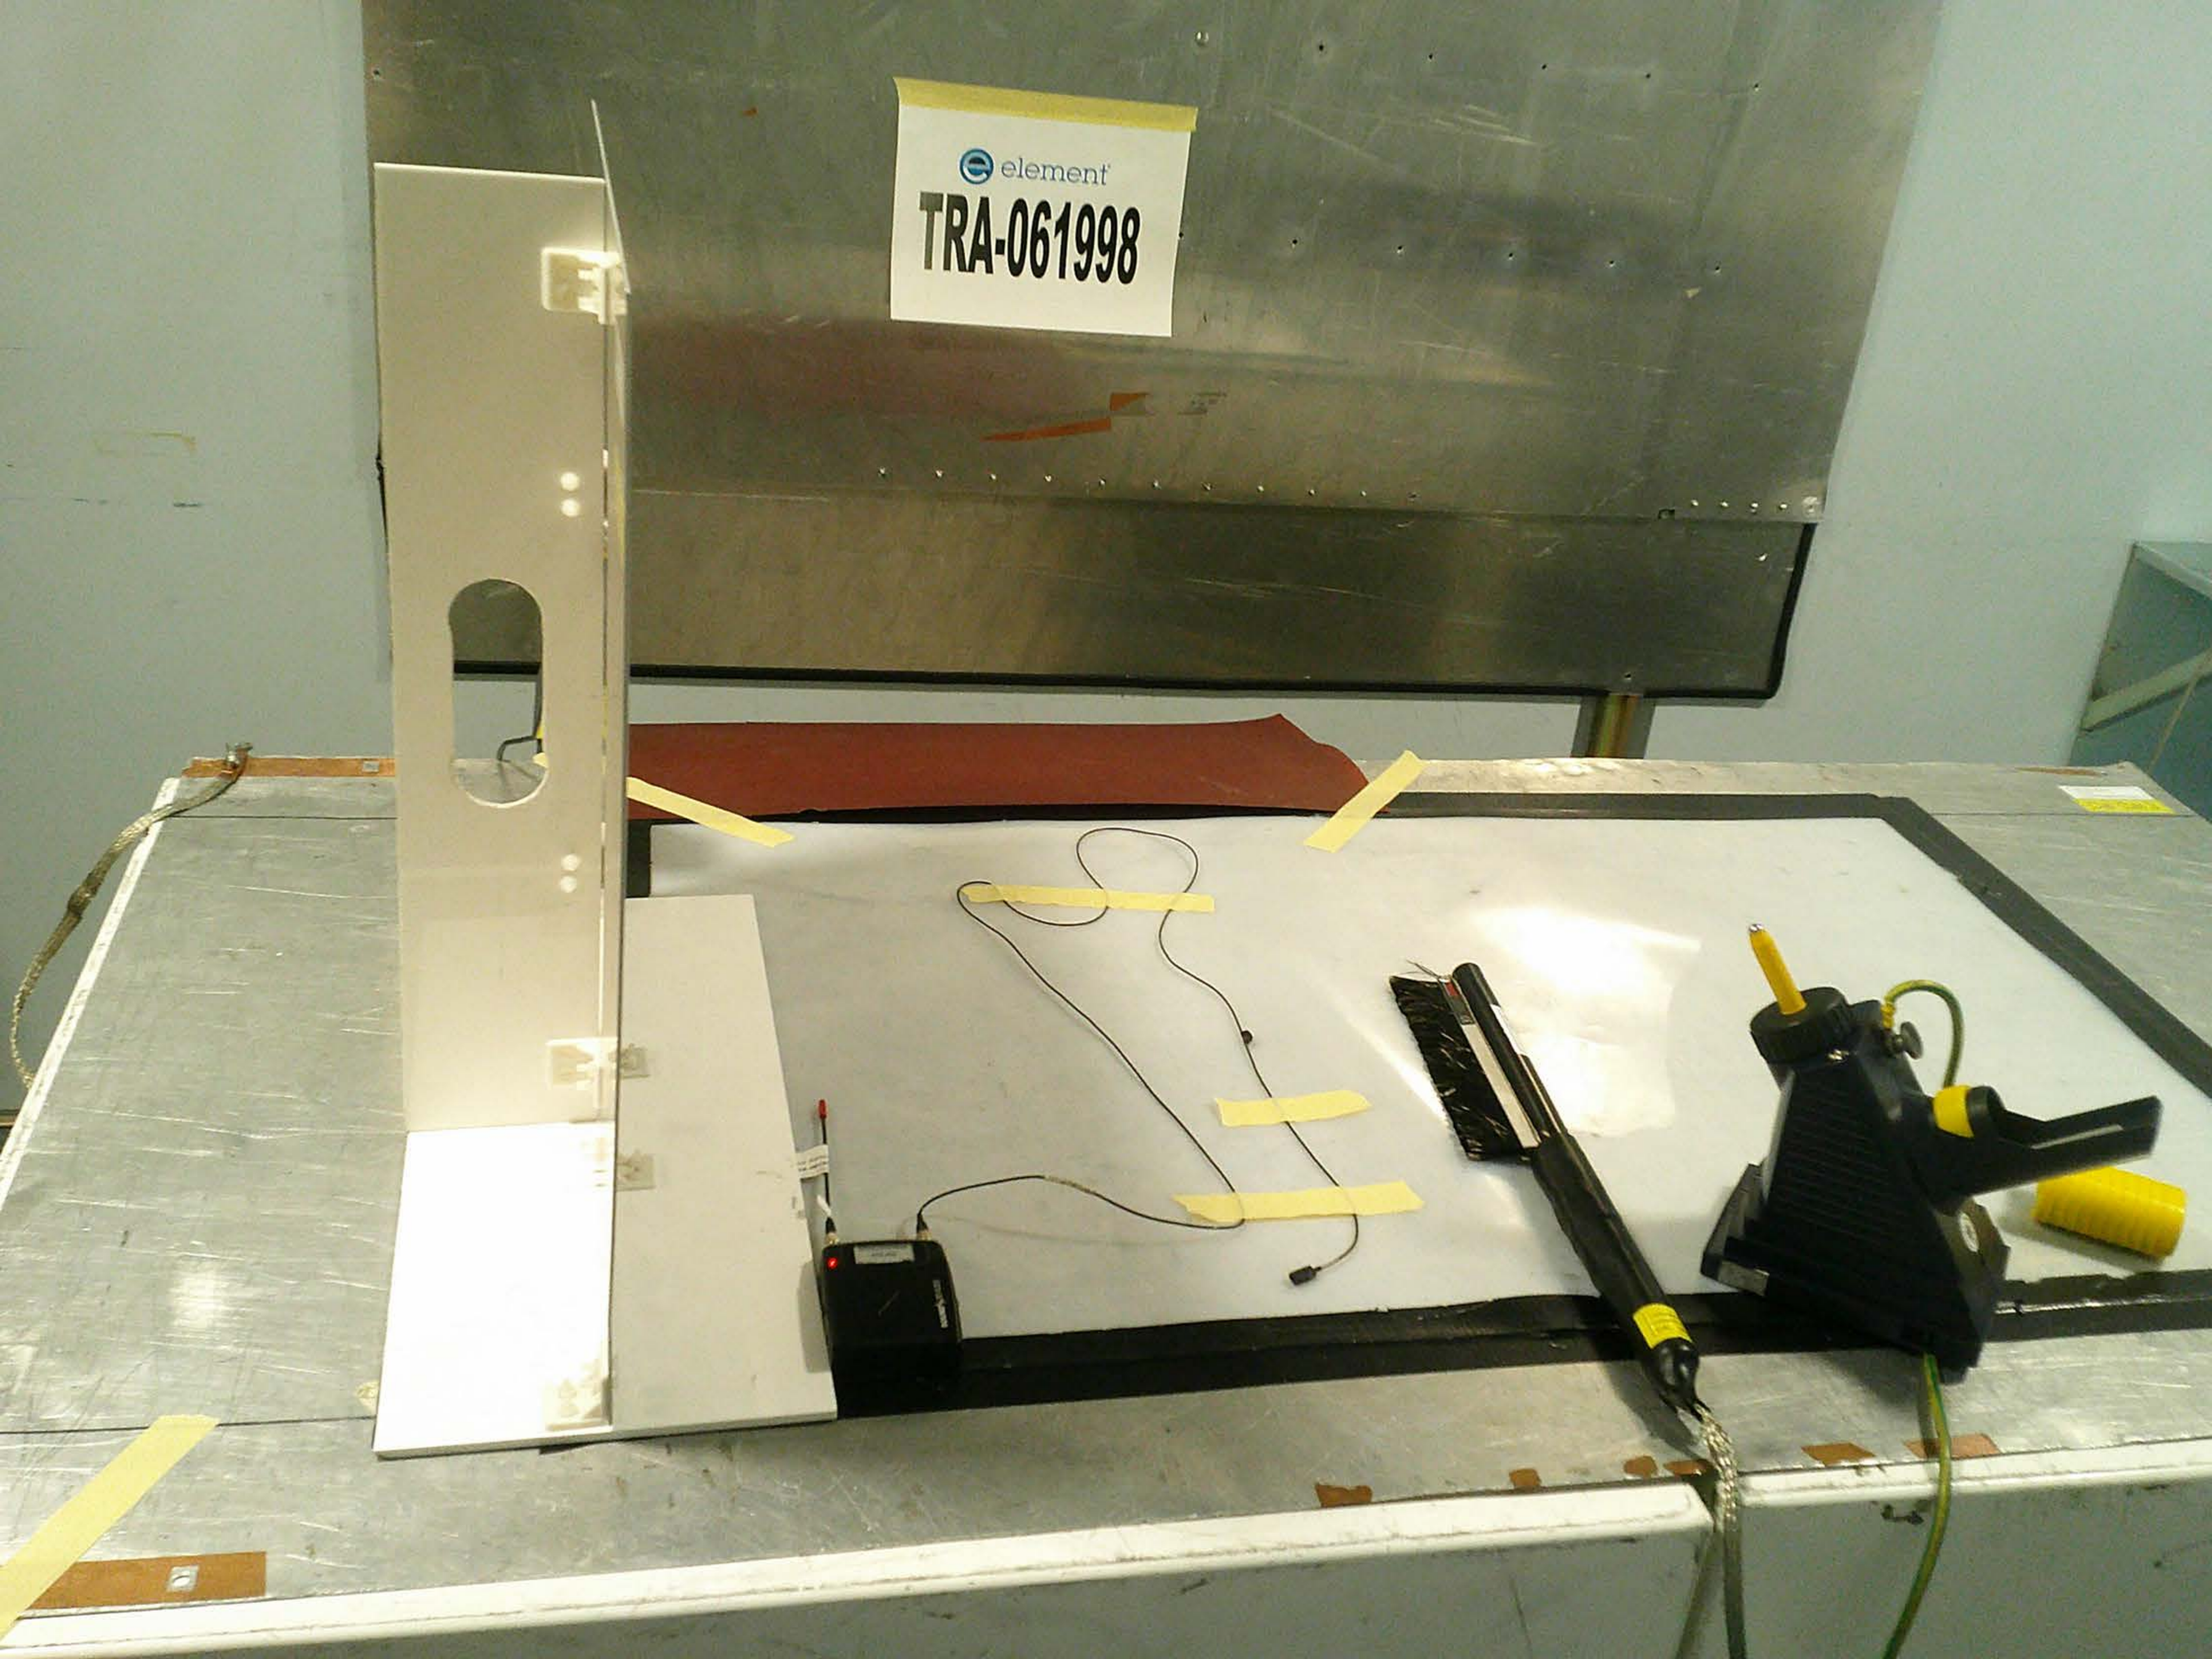

Test Sample
TRA-20170

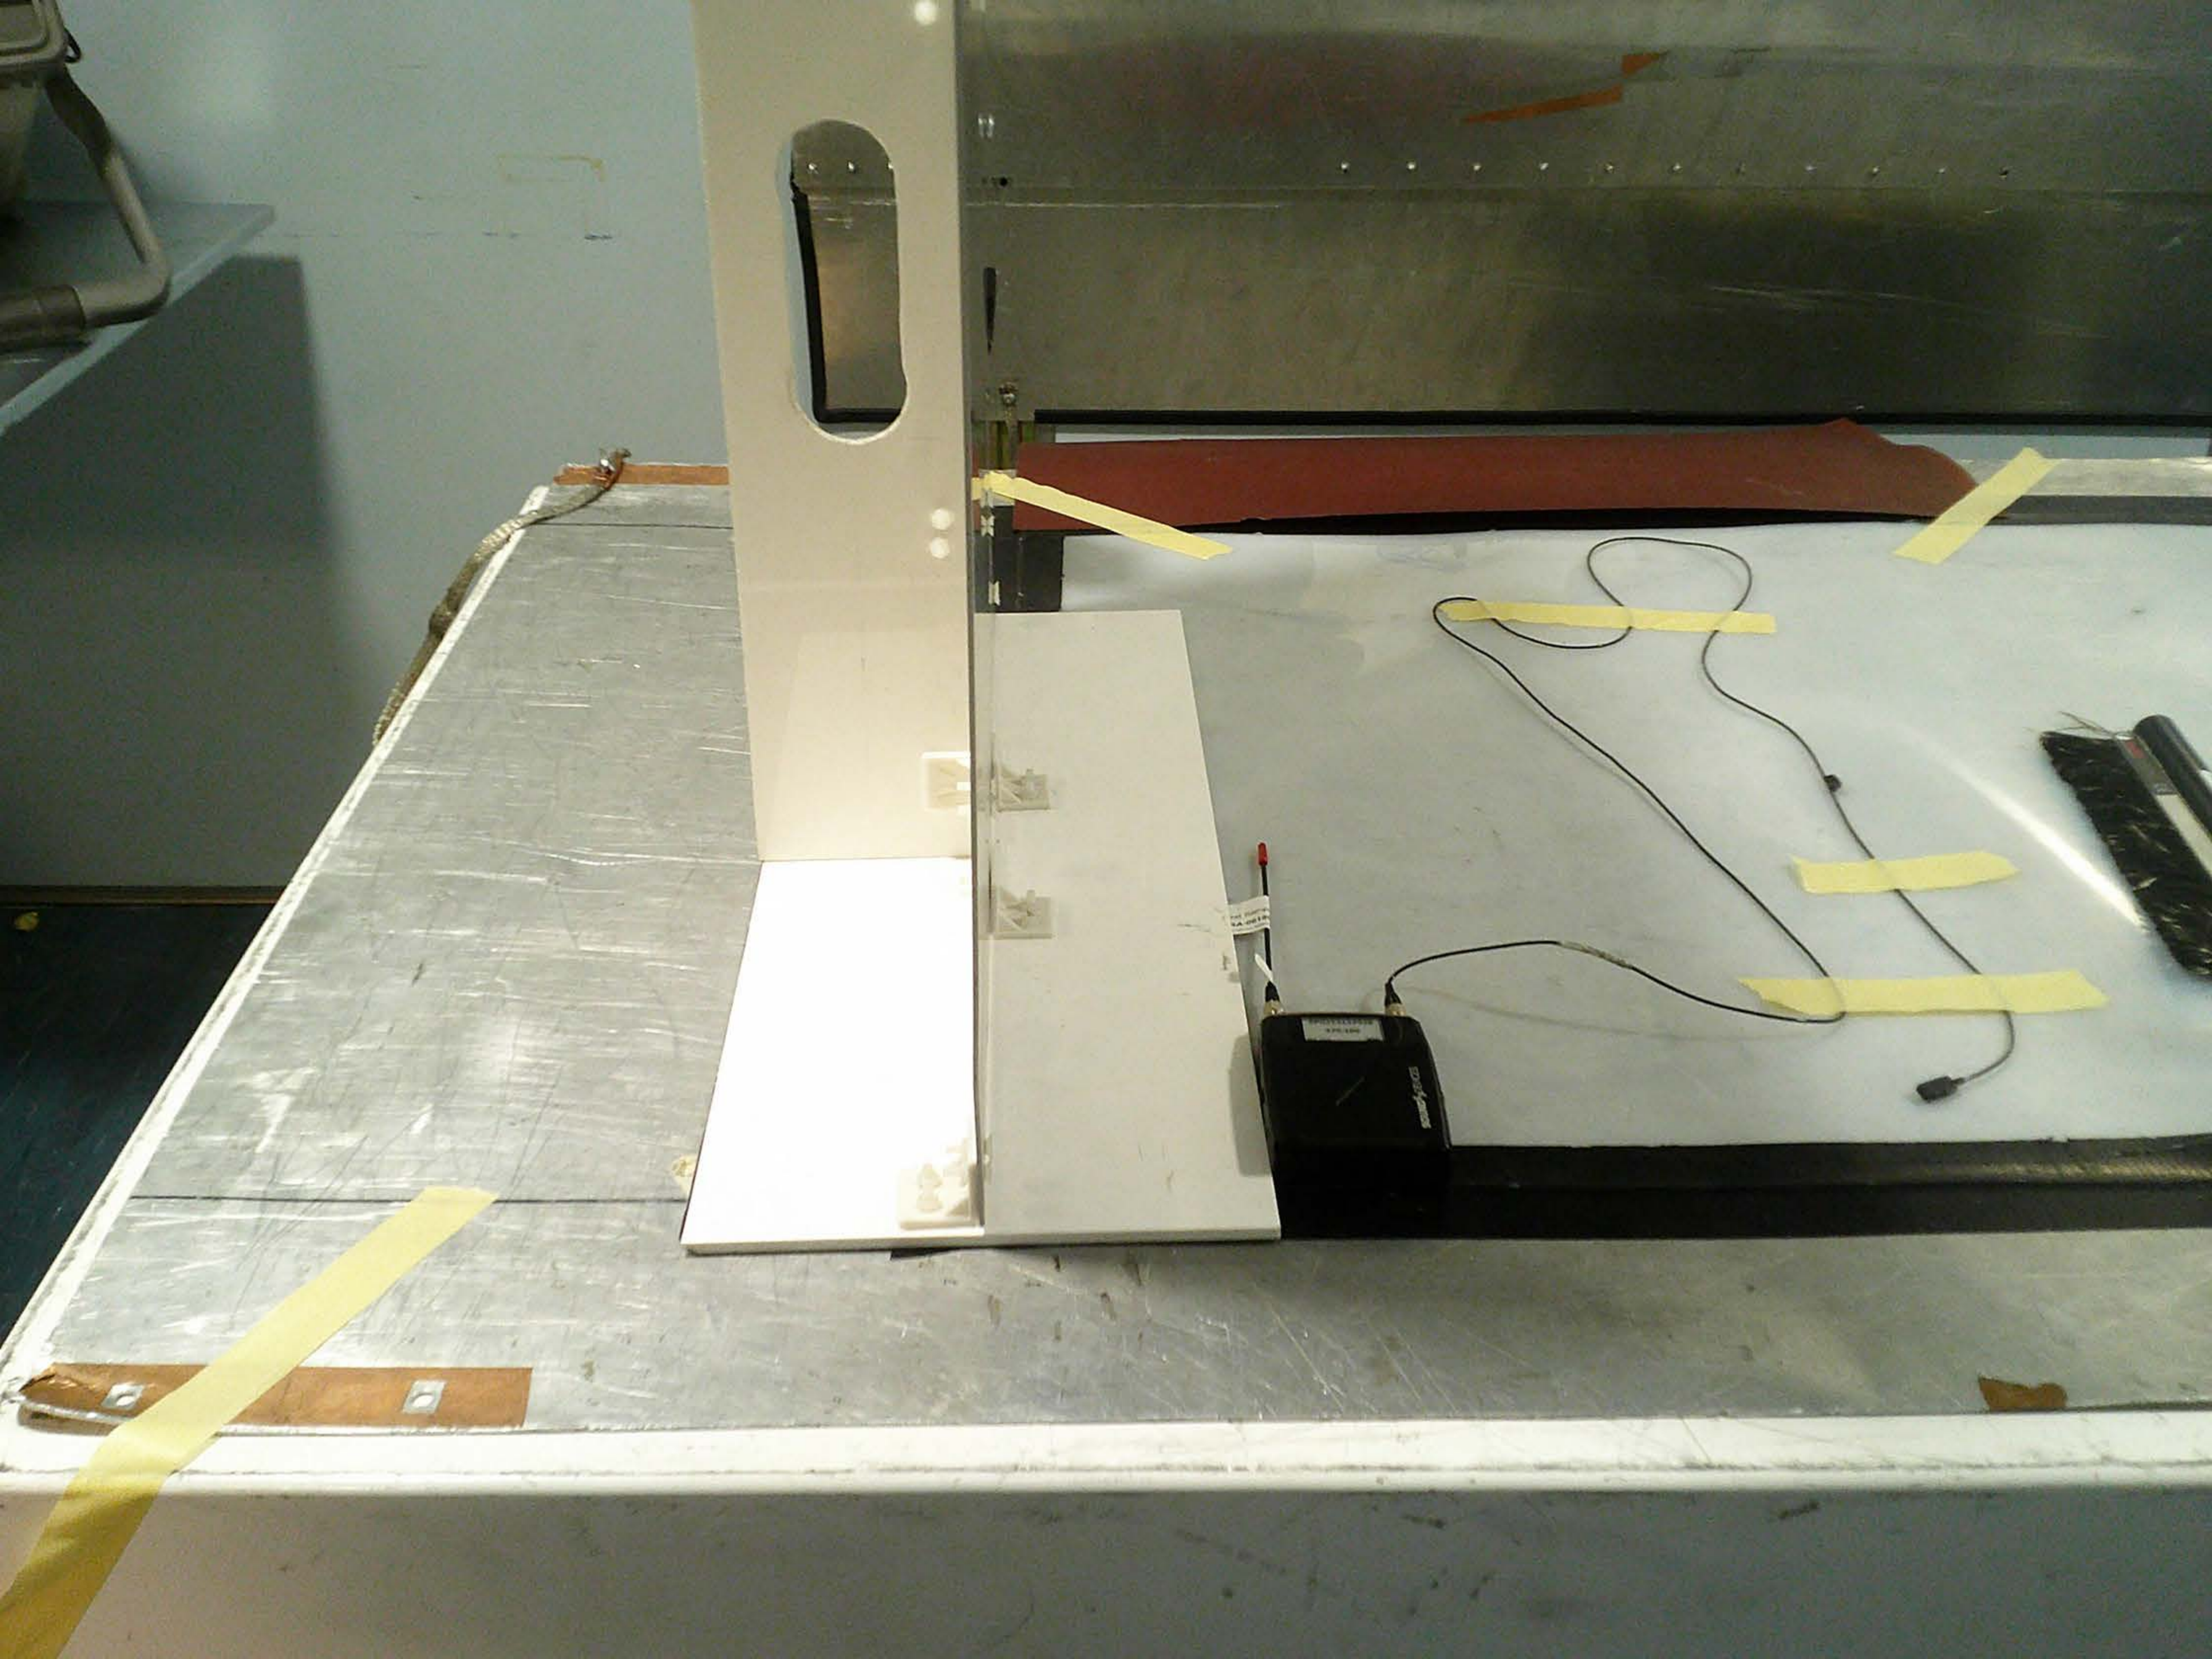



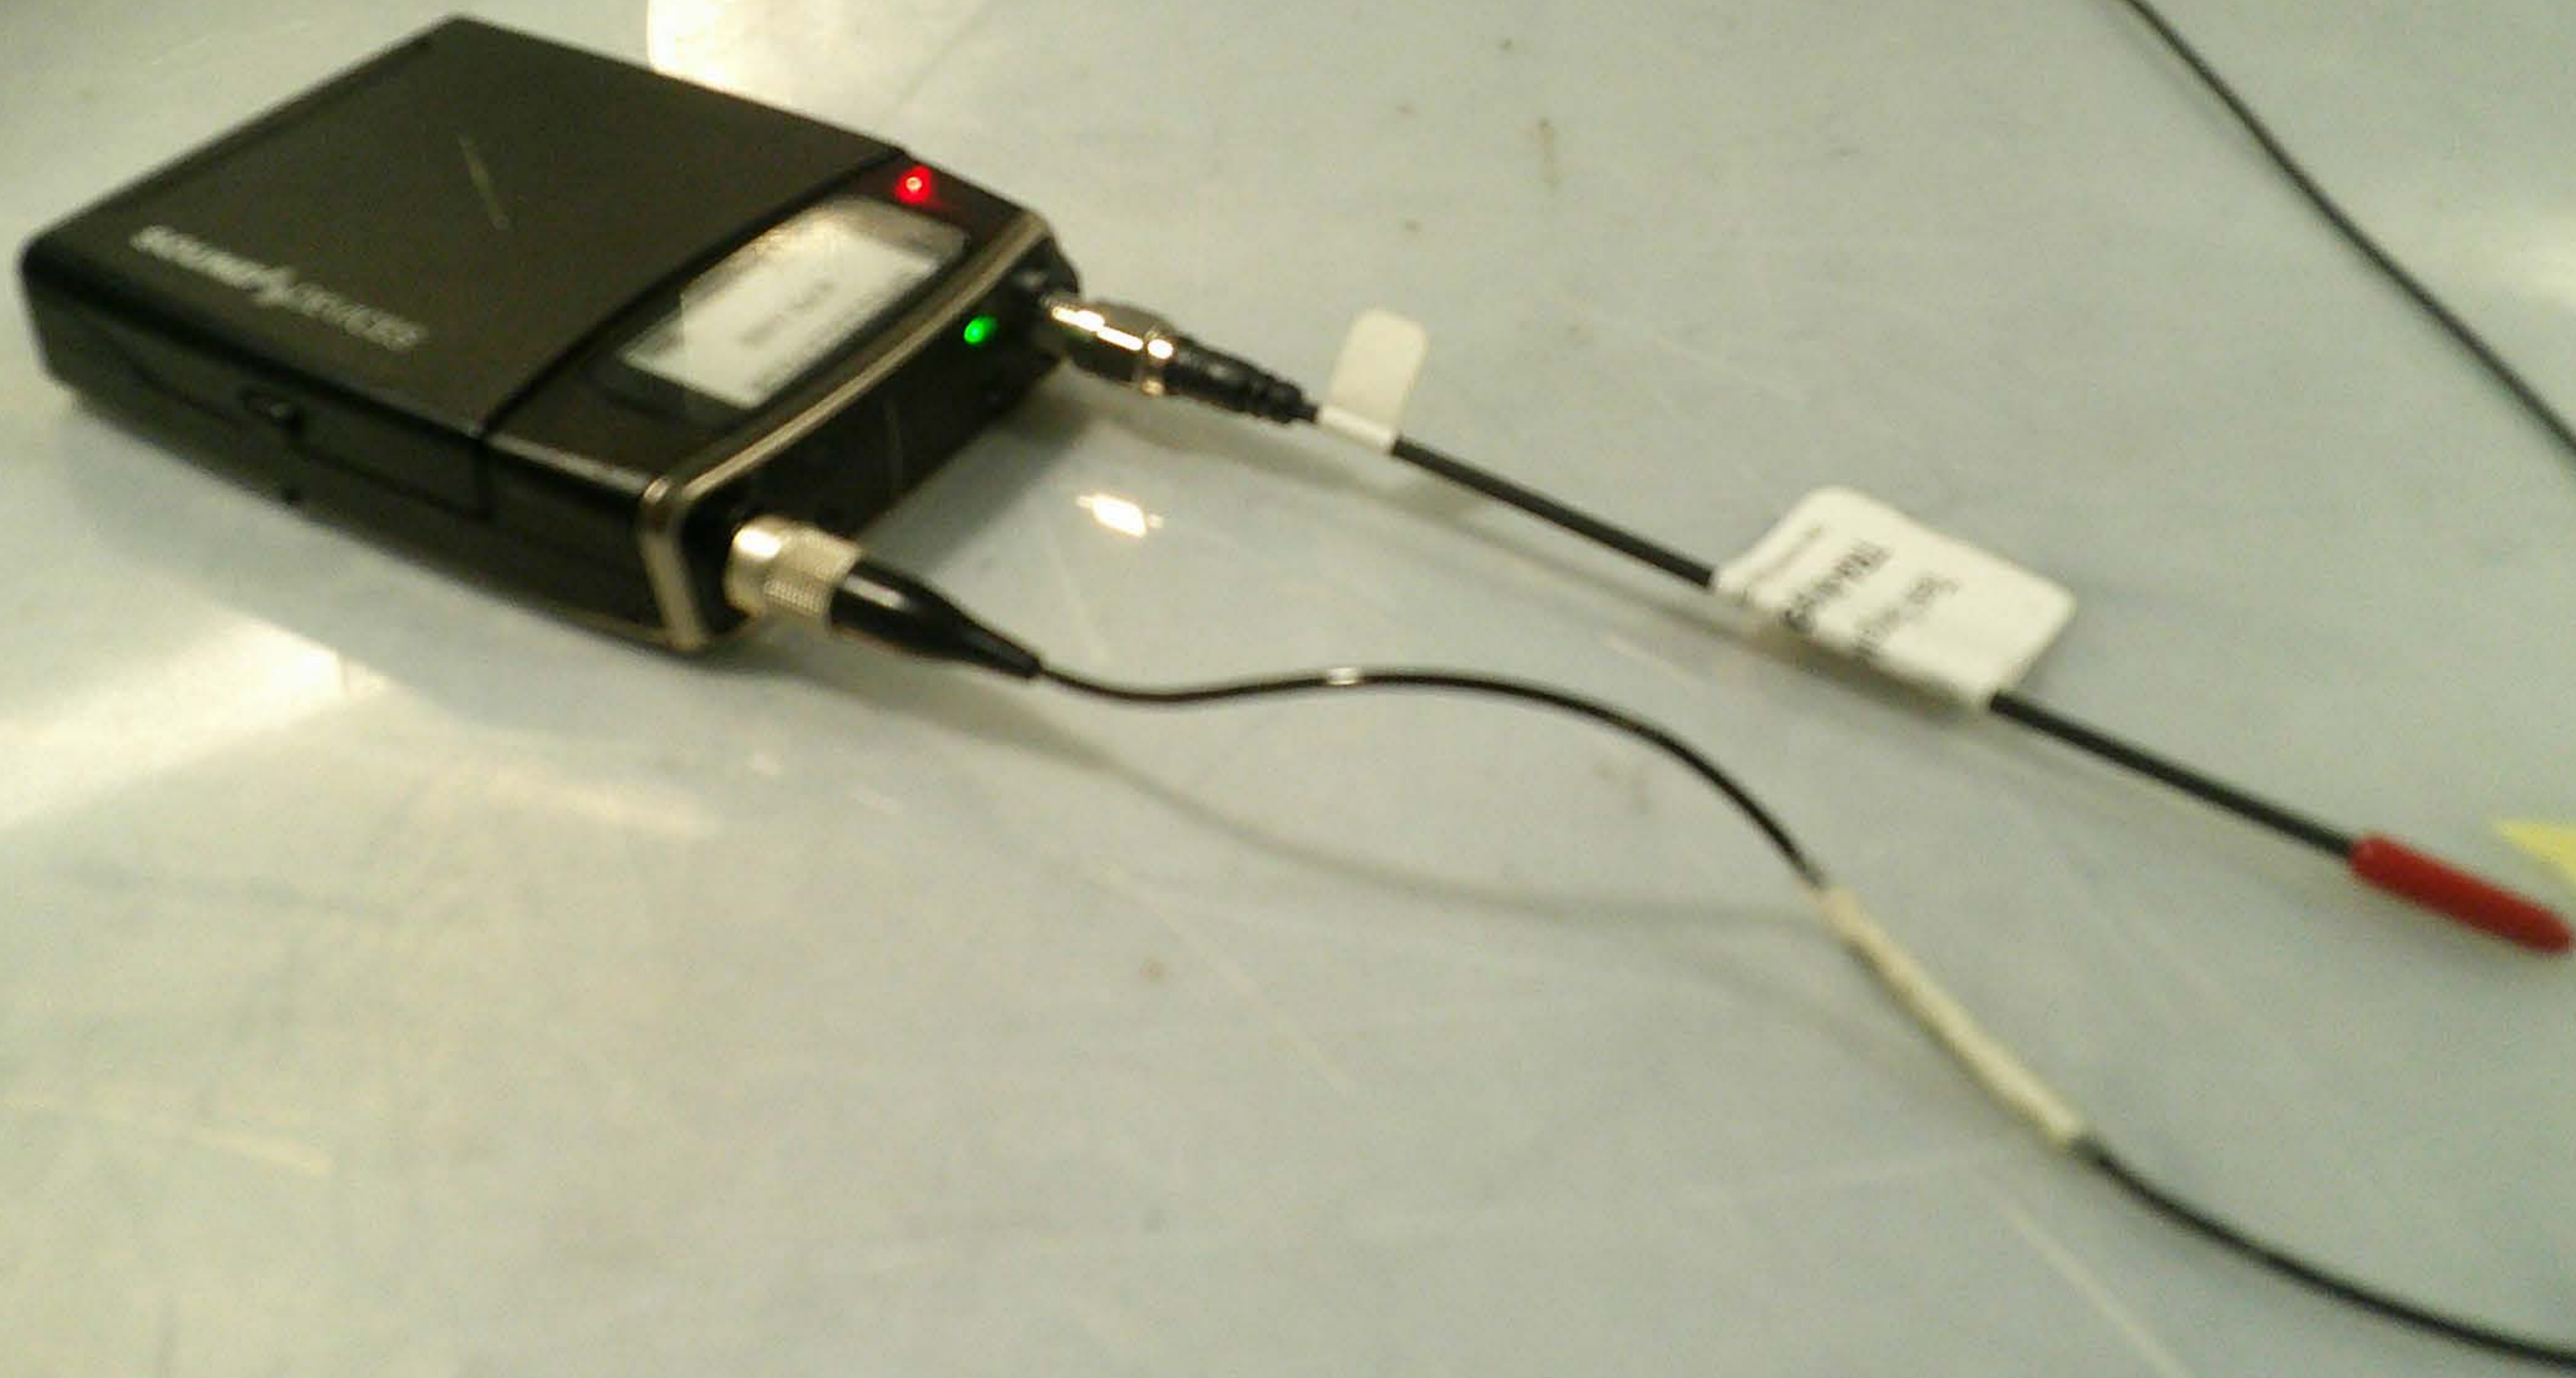



MDR-EX255
4.7MB 32KB

SONY

RIGOL

DS1204B

DIGITAL OSCILLOSCOPE

LXI

4 Channel

200MHz 2GSa/s

STOP 50.00ns




F 46.4mV

46.8V

-800mV

$\Delta Y = -47.6V$

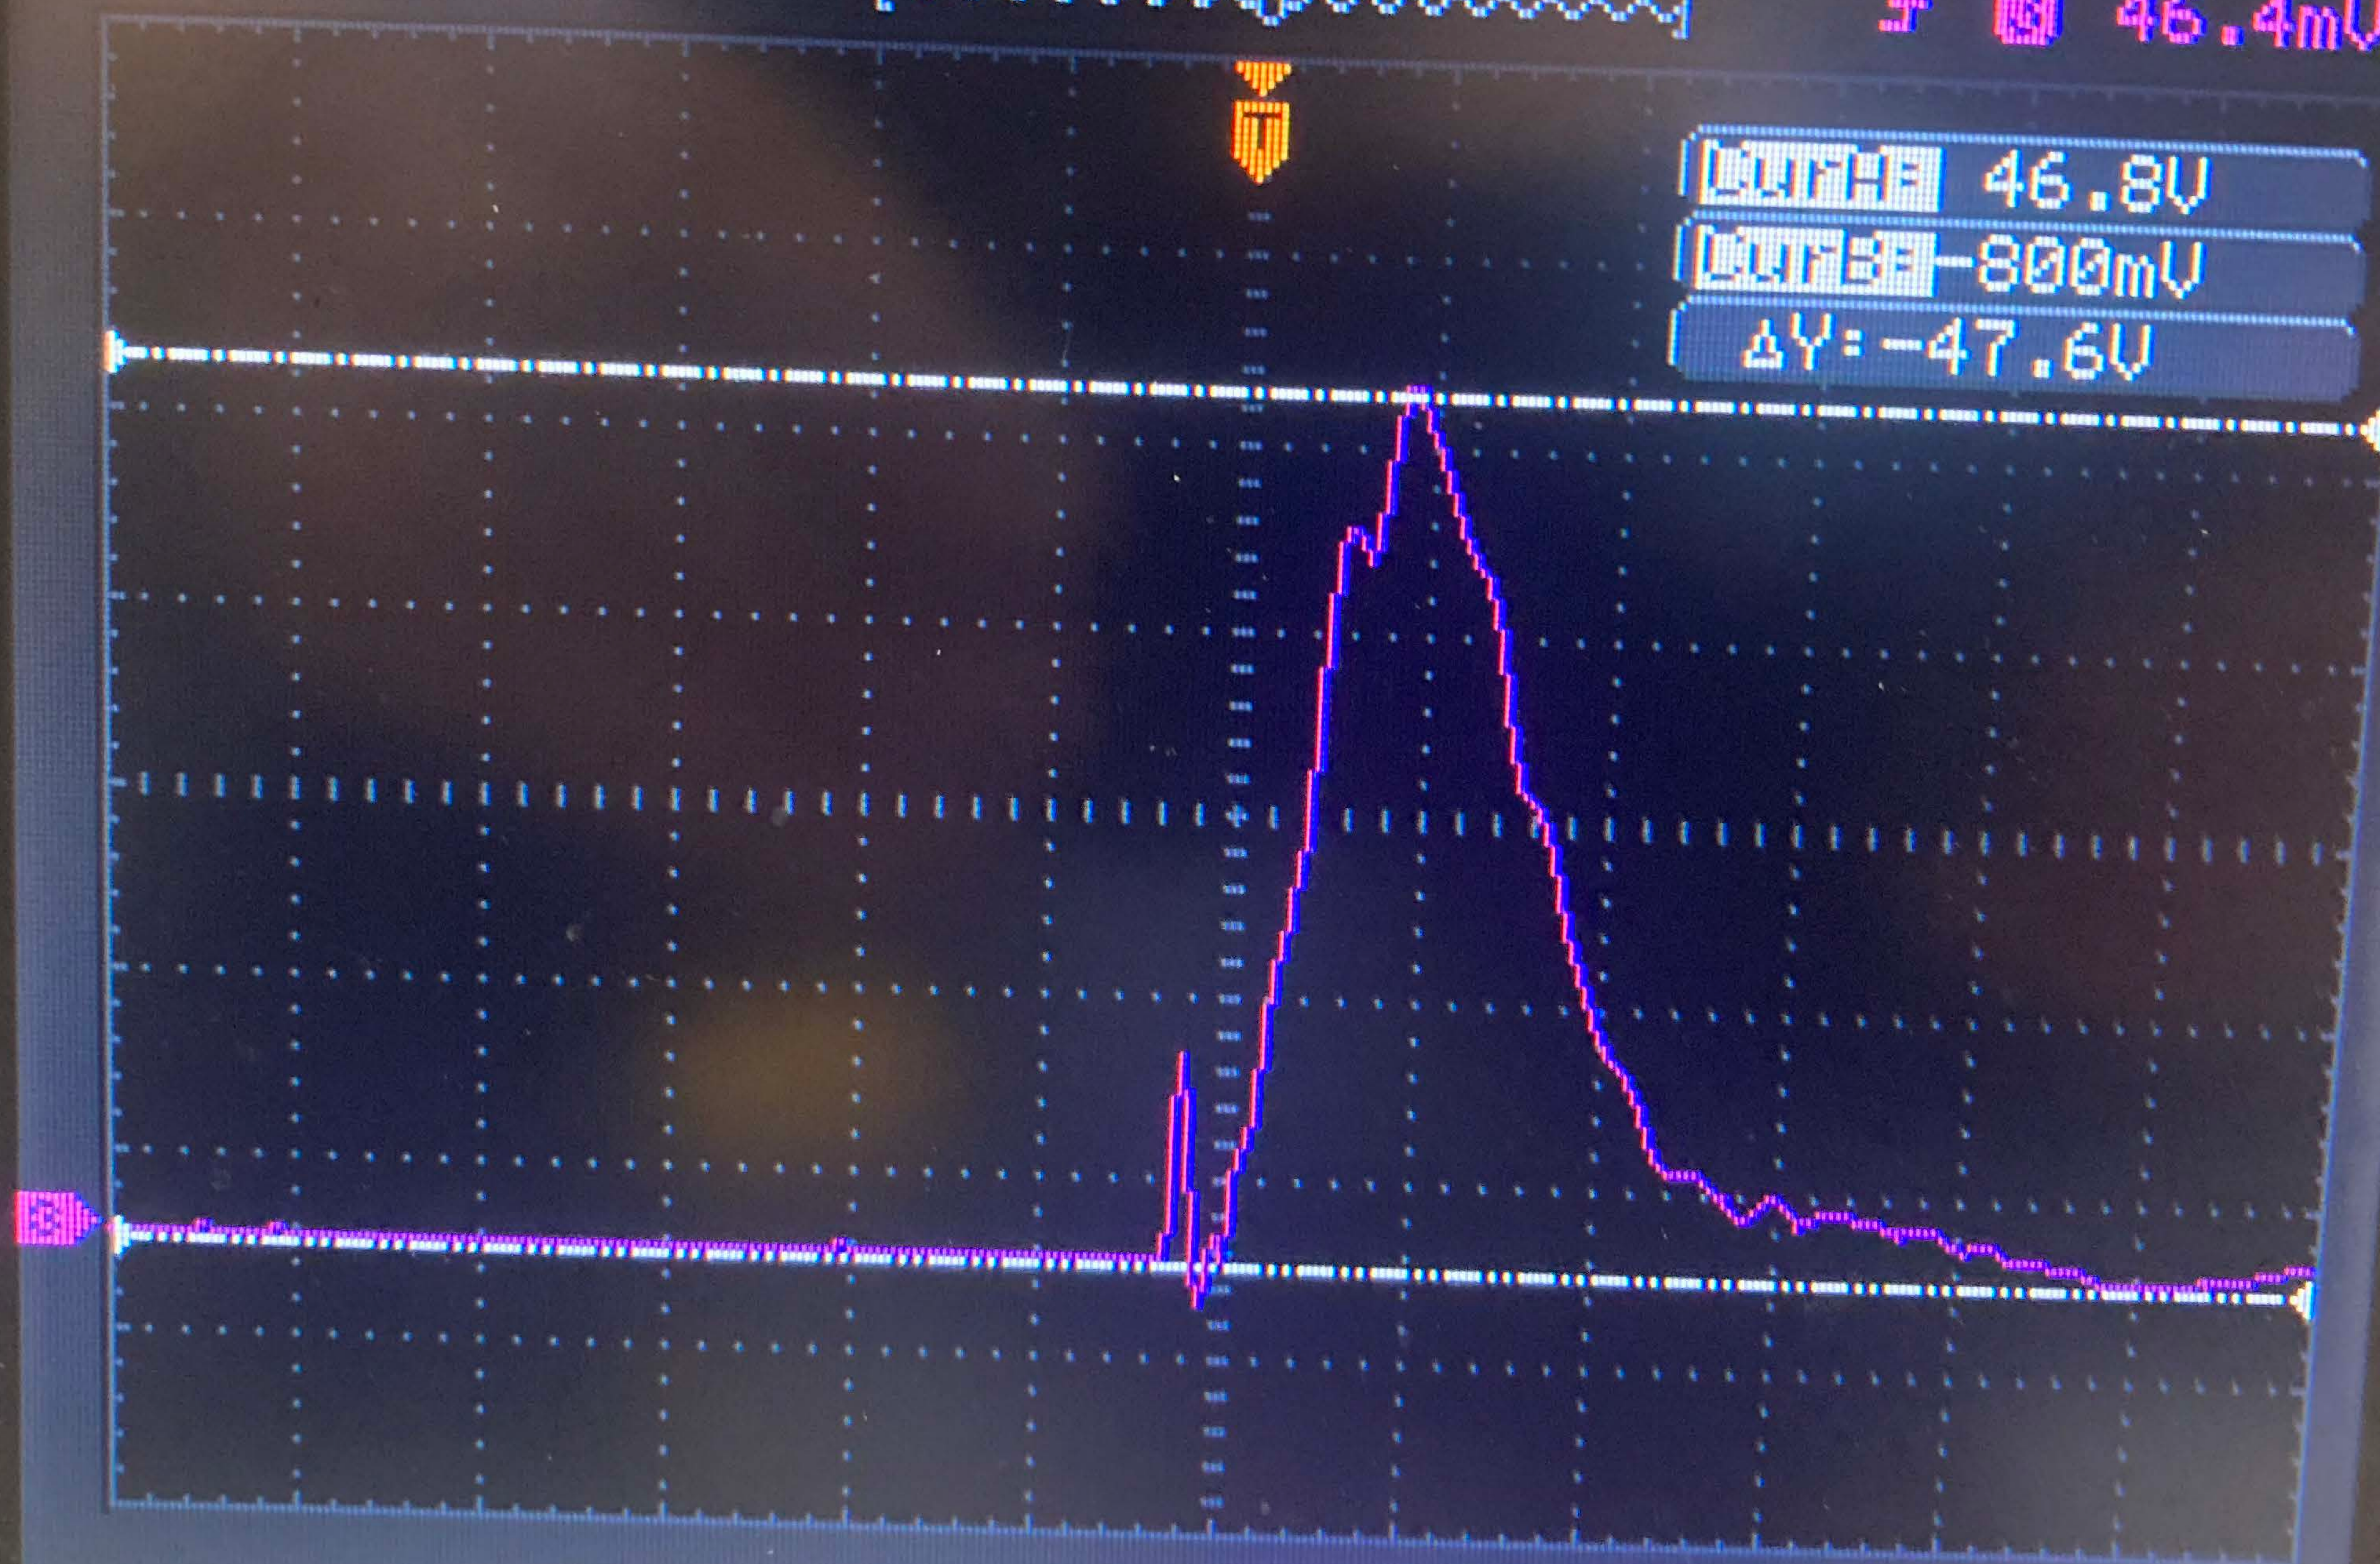

10.0V